


DUCK LAKE

2022 Water sampling results in E-Coli/ml

Readings of 300 or more are retested for Animal or Human

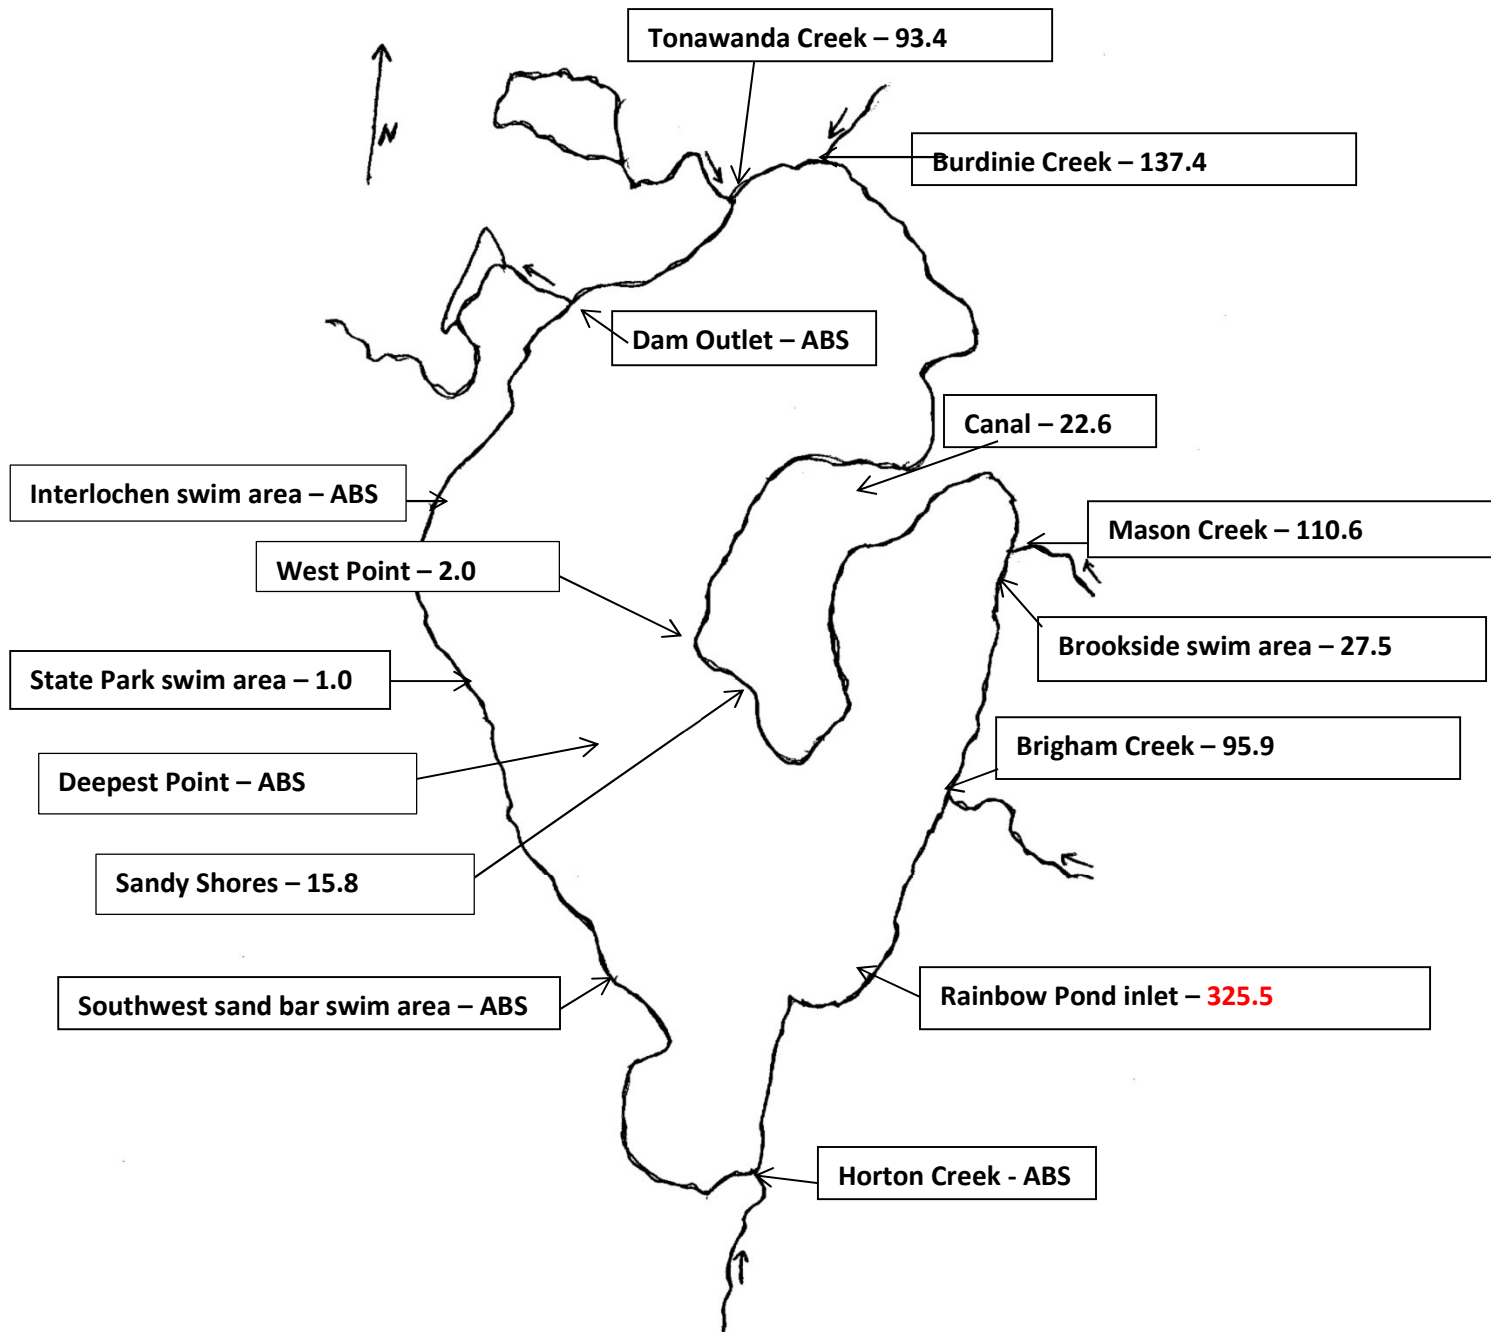

ABS = Absent